



# DETACHED ACCESSORY STRUCTURE REQUIREMENTS

THE FOLLOWING ARE MINIMUM REQUIREMENTS FOR CONSTRUCTION

TYPICAL REQUIREMENTS FOR UNHEATED DETACHED STRUCTURES


## GARAGE DOOR HEADERS

(BASED ON 24'-0" SPAN AND SUPPORTING ROOF TRUSSES)

9'-0" DOORS - DOUBLE 2X10 WITH 1/2" PLYWOOD GLUED AND NAILED IF BEARING

16'-0" DOORS - TRIPLE 2X14 OR DOUBLE 12" MICRO LAM OR PARA LAM IF BEARING

NOTE: SINGLE STUD BEARING REQUIRED FOR 9'-0" DOORS,  
TWO STUD BEARING REQUIRED FOR 16'-0" AND 18'-0" DOORS

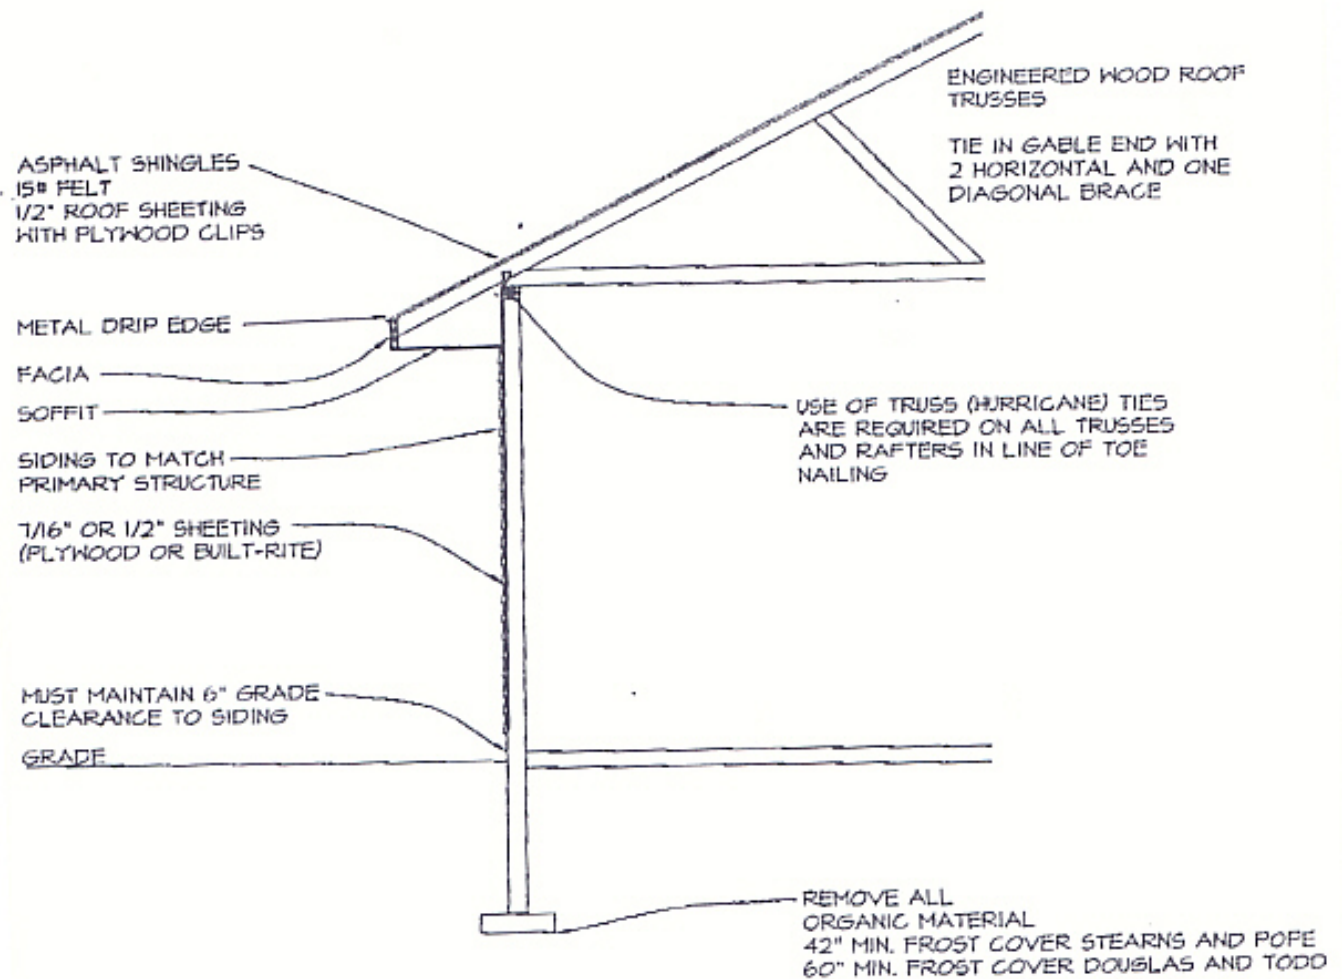

SLAB ON GRADE CONSTRUCTION  
EXHIBIT (9)